

Maine Combined Sewer Overflow 2017 Status Report

April 2018

Contact: Michael S. Riley, P.E.
CSO Coordinator
Bureau of Water Quality
Phone: (207) 287-7766

Document No.: DEPLQ0972I-2018



MAINE DEPARTMENT OF ENVIRONMENTAL PROTECTION
17 State House Station | Augusta, Maine 04330-0017
www.maine.gov/dep

TABLE OF CONTENTS

| | |
|---|---|
| INTRODUCTION..... | 1 |
| WHAT ARE CSOS?..... | 1 |
| WHAT ARE THE IMPACTS OF CSOS?..... | 2 |
| WHAT IS A CSO COMMUNITY?..... | 2 |
| WHERE DID WE START?..... | 3 |
| WHAT IS BEING DONE TO ABATE CSO DISCHARGES?..... | 3 |
| WHERE ARE WE NOW? - 2017 STATUS..... | 4 |
| WHERE ARE WE NOW? - OVERALL TRENDS AND CONSIDERATIONS | 6 |

TABLES

| | |
|---|----|
| MAINE - CSO COMMUNITY LIST | 8 |
| MAINE - CSO COMMUNITY FLOW DATA..... | 9 |
| MAINE - CSO COMMUNITY ANNUAL NUMBER OF CSO DISCHARGE EVENTS | 10 |
| MAINE - CSO COMMUNITY ANNUAL NUMBER OF CSO OUTFALLS..... | 11 |
| MAINE - ANNUAL CSO VOLUME DISCHARGED BY WATERSHED..... | 20 |

CHARTS

| | |
|--|----|
| MAINE – STATEWIDE COMBINED SEWER OVERFLOW VOLUME DISCHARGED..... | 12 |
| MAINE – STATEWIDE COMBINED SEWER OVERFLOW ANNUAL NUMBER OF DISCHARGE EVENTS..... | 13 |
| MAINE – STATEWIDE NUMBER OF COMBINED SEWER OVERFLOW OUTFALLS..... | 14 |
| MAINE COMBINED SEWER OVERFLOWS ANNUAL VOLUME DISCHARGED PER INCH OF PRECIPITATION | 15 |
| MAINE YEARLY CSO VOLUMES AND PRECIPITATION..... | 16 |
| MAINE 2017 CSO FLOW COMPARISON - PIE CHART | 17 |
| MAINE 2017 CSO FLOW COMPARISON BY COMMUNITY - BAR CHART..... | 18 |
| MAINE 2017 CSO VOLUME DISCHARGED BY WATERSHED - PIE CHART..... | 19 |

Introduction

The purpose of this report is to inform the Combined Sewer Overflow (CSO) communities and the general public on the status of the CSO program in the State of Maine.

The CSO program compiles information from various documents and reports submitted to the Maine Department of Environmental Protection by the CSO Communities (City/Town/District) or their consultants on their behalf. A majority of the information comes from the CSO Master Plans (a.k.a. Long Term Control Plans), Sewer System Evaluation Studies, Inflow/Infiltration Reports, Annual CSO Progress Reports, and general correspondence.

At the start of any CSO Community's abatement program, initial flow data was collected to estimate the existing discharge volumes and frequencies, define the problems, and establish a corrective course of action. This often occurred over a relatively short period of time (a year or two) and may not have captured as many representative wet weather events as desired. However, this data was the best available information at the time and established the overflow baselines that are used within this report. Since then, CSO flow monitoring plans have continued to improve and overall data reliability has increased, giving the program better data for specific yearly wet weather patterns.

What Are CSOs?

- Combined Sewer Systems (CSS) – are defined as collection systems which carry a combination of sanitary wastewater, stormwater, and sometimes industrial wastes within the same pipes. They are typically older collection systems designed and installed prior to advent of wastewater treatment facilities.
- Combined Sewer Overflows (CSOs) are discharges of untreated wastewater from municipal CSS's. CSO's typically consist of two components; a CSO Regulator where the untreated wastewater exits the sewer system, and a CSO outfall where the wastewater is discharged to a receiving water.
- CSO discharges occur mostly during and after rain events or snowmelt. Flows within the CSS during these wet weather events can be as high as fifty (50) times the normal dry weather flows.
- Large volumes of water entering the CSS through catch basins, old and leaky pipes, roof drains, cellar drains, sump pumps, and other sources can cause the capacity of the system to be exceeded, resulting in discharges.
- CSO's were originally added as hydraulic relief points within the CSS to allow the excess flows to be discharged. These relief points are generally at topographic low points, near pump stations and river crossings.

What Are The Impacts Of CSOs?

- Currently there are 31 Maine communities (Towns, Cities, Utility Districts) with CSO discharge points in their sewerage systems (reduced from an original 60). These communities collectively have 139 individual CSO discharge points (reduced from the original 340).
- The frequency of discharges varies greatly from community to community, ranging from seldom, to occurring in response to all but the smallest rain storms.
- In large communities hundreds of millions of gallons per year of untreated combined sanitary sewage and storm water may be discharged. In the past three years statewide, total annual CSO discharges have ranged from approximately 294 to 548 million gallons. For comparison, the estimated volume from 1989, when most CSO abatement programs were just starting, was 6.2 billion gallons.
- CSO's discharge untreated combined sewage to receiving waters that vary in size from the Atlantic Ocean and large rivers to small streams and drainage creeks.
- Water quality is impaired by the addition of floatable solids, bacteria, and sometimes industrial pollutants that may be present in CSO discharges.
- Potential public health impacts from CSO discharges include the closure of beaches and shellfishing areas due to bacterial contamination, and the potential for drinking water supplies to be threatened.
- During wet weather, flows in a CSS can hydraulically overload the capacity of the collection system leading to treatment facility upsets, sanitary sewer overflows (SSO's), street flooding, and back-ups into basements.

What Is A CSO Community?

- CSO communities are permitted dischargers of untreated combined sanitary and storm waters. The Department of Environmental Protection issues CSO communities a wastewater discharge license that requires them to implement the Environmental Protection Agency's (EPA) Nine Minimum Control Best Management Practices (BMPs) for CSO's and develop, maintain and implement a CSO Master Plan (aka the Long Term Control Plan (LTCP)) to eliminate or abate their overflows, bringing them into compliance with EPA's April 19, 1994 Combined Sewer Overflow (CSO) Control Policy, the Clean Water Act, and State law.
- Special Conditions in a CSO community's Maine Pollutant Discharge Elimination System (MEPDES) permit/Waste Discharge License require all CSO communities to submit an Annual CSO Progress Report to the Department for the previous year, by March 1st of the following year.
- The Annual CSO Progress Report documents the community's efforts to comply with the Nine Minimum Controls for CSO abatement, and collects pertinent fiscal and logistical information about their CSO abatement program. This information is used to track their CSO abatement progress and gather state-wide information on the CSO program and fiscal needs.

Where Did We Start?

- The CSO movement began in 1989 with the publication of the National CSO Control Strategy by the EPA.
- At that time, the State of Maine had about 60 CSO Communities that discharged an estimated 6.2 billion gallons of untreated wastewater and storm water into the surface waters of the State, primarily during wet weather events.
- At the start of the program in the late 1980's, CSO communities reported that over 1,700 individual CSO discharge events were occurring each year, through approximately 340 CSO outfall locations (an average of 5 discharge events per CSO location per year).
- On April 19, 1994 EPA issued a national policy statement entitled "Combined Sewer Overflow (CSO) Control Policy." This policy provided guidance to State permitting authorities and CSO communities on coordinating the planning, selection, and implementation of CSO controls, that once implemented, would allow CSO communities to achieve compliance with the requirements of the Clean Water Act (CWA).
- In February 2000, the Maine Department of Environmental Protection Chapter 570 Rules, entitled "Combined Sewer Overflow Abatement," took effect. This chapter established procedures for CSO evaluation, preparation of an abatement plan, and set forth minimum controls to reduce CSOs while long-term plans are completed.
- In December 2000, as part of the Consolidated Appropriations Act for Fiscal Year 2001 (P.L. 106-554), Congress amended the Clean Water Act (CWA) by adding Section 402(q), commonly referred to as the Wet Weather Water Quality Act of 2000. Section 402(q) requires that each permit, order, or decree issued pursuant to the CWA for a discharge from a municipal combined sewer system shall conform to the 1994 EPA CSO Control Policy.

What Is Being Done To Eliminate / Abate CSO Discharges?

- All of Maine's CSO Communities have completed or are currently working on implementing the CSO controls recommended in their CSO Master Plan, often referred to as a Long Term Control Plan. These documents define the magnitude of the CSO discharges, their impacts on the environment, evaluate a range of abatement control alternatives and their financial impacts, and recommend a set of CSO controls that will eliminate / abate CSO discharges.
- CSO abatement projects have reduced the discharge of untreated, combined sewage to receiving waters in all of the CSO Communities. Fourteen communities have eliminated their CSO discharges entirely and are no longer licensed to discharge untreated combined sewage during wet weather.
- Statewide, **currently licensed** CSO Communities have reported investing approximately \$579 million in CSO abatement since the program started (\$34 million in 2017 alone). Of the total invested to date, the Maine Clean Water State Revolving Fund (CWSRF) has contributed \$340.7 million (63% of total expenditure on CSO abatement

by current CSO communities).

- Statewide, **previously licensed** CSO Communities, that since have left the program, reported investing a total of approximately \$462 million on CSO abatement, with the CWSRF providing \$114.7 million of that total (25% of total expenditure on CSO abatement by prior CSO communities).
- Anticipated infrastructure needs of current CSO communities over the next five years are estimated to be approximately \$201 million.

Where Are We Now?

2017 Status

- 1) In 2017, the 31 currently licensed CSO Communities reduced the total number of CSO discharge locations by three (3), from 142 to 139, (a complete listing of Maine's CSO Communities, the number of CSO locations, and the corresponding receiving waters are listed on page 8). CSO's were closed in the communities of Biddeford (1), Bucksport (1), and Saco (1). With the addition of 2017 data, the chart on page 14, **Maine Statewide Number of Combined Sewer Overflow Outfalls**, shows a 59% reduction in the overall number of CSO locations in Maine since 1988.
- 2) In 2017, the CSO Communities reported a total of 269 overflow event days which is the number of days that each CSO Community experienced an overflow. An overflow event is any calendar day that one or more CSO locations within a community experiences a discharge. The table on page 10, **Maine CSO Community Annual Number of CSO Discharge Events**, contains a historic listing of the annual number of CSO discharge events for each CSO Community.
- 3) The maximum number of overflow event days reported in 2016 from a single CSO community was fifty-five (55). The average (mean) number of discharge event days for all communities was nine (9) event days and the median was two (2) event days. Additional information can be found in the table on page 10, **Maine CSO Community Annual Number of CSO Discharge Events**.
- 4) Since 1989, the statewide average annual precipitation in Maine has been approximately 47 inches. In 2017, the annual precipitation measured by CSO Communities varied significantly from 31.92 to 47.84 inches with an average of 40.52 inches. The **Maine Yearly CSO Volumes and Precipitation** chart on page 16 compares annual CSO discharge volumes to annual precipitation. The chart illustrates that CSO discharge volumes tend to mirror the annual upward and downward trends in precipitation totals. The chart also shows a progressive widening of the gap between the annual precipitation trend line and the annual CSO discharge volume trend line. This widening gap appears to indicate that as CSO abatement projects continue to be completed, overflow volumes are becoming less influenced by precipitation events.
- 5) The CSO volume discharged statewide in 2017 was reported to be approximately 294 million gallons. The table on page 9, **Maine CSO Community Flow Data**, contains a historic listing of the annual overflows from each CSO Community. The **Maine 2017**

CSO Flow Comparison pie chart on page 17 and the **Maine 2017 CSO Flow Comparison by Community** bar chart on page 18 show graphical comparisons of these overflow volumes between the CSO Communities.

- 6) The precipitation in 2017 had a weighted average of 40.35”, which was 4% lower than 2016’s precipitation. This 1.6” drop in annual precipitation in 2017 contributed to a 46% decrease in overall CSO discharge volume compared to the previous year, from 548.6 MG to 294.5 MG.
- 7) A comparison of statewide annual precipitation totals over a longer time frame, indicates the 2017 total of 40.35” falls below the weighted average precipitation for the previous five years (44.4”), and below the weighted average precipitation since 1989 (47.07”). If one compares the 2017 overflow volume (294.5 MG) with the average overflow volume from the previous five years (740.2 MG), it shows a reduction of approximately 60%, while the rainfall in 2017 was only 9% less than the average rainfall for the same five-year period.
- 8) In 2017, the top five (5) CSO communities, ranked by discharge volume, accounted for approximately 92.7% of the total CSO volume discharged in the State. The top ten (10) CSO communities accounted for approximately 98% of the total CSO discharge volume. The remaining twenty-one (21) CSO communities accounted for less than 2% of the total CSO discharge volume. See the **Maine 2017 CSO Flow Comparison** pie chart on page 17 for a graphical comparison of CSO dischargers.
- 9) CSO discharges by the City of Portland and the Portland Water District accounted for approximately 60% of Maine’s total CSO discharge volume in 2017; see the **Maine 2017 CSO Flow Comparison** pie chart on page 17. Given the outsized impact that Portland’s CSO discharge contribution has on the State’s total discharge volume, it may be informative to exclude Portland’s data when examining Maine’s overall CSO abatement progress. After removing Portland’s CSO discharge volume from the state total, the overflow volume from the remaining thirty CSO Communities decreased from approximately 155.2 million gallons in 2016, to 118 million gallons in 2017, a reduction of over 23%.
- 10) The chart on page 19 – **Maine 2017 CSO Volume Discharged by Watershed**, is a graphical representation of the CSO volumes discharged by major watershed. In 2017, Casco Bay received approximately 60.9% of the statewide CSO volume discharged, followed by the Saco River at 16.9%, the Androscoggin River at 12.4%, the Penobscot River at 4.5%, the Kennebec River at 3.1%, and the St. Croix River at 1.5%. Discharges to Frenchman Bay, the St. John River, and the Machias River accounted for the remaining ~0.7% of combined sewer overflow volumes. The 2017 data shows a significant reduction in CSO discharge volume compared to 2016 for the Androscoggin River (a 20.7% decrease), the Kennebec River (34.8%), the Penobscot River (73.5%), the Saco River (50%), the Machias River (77.6%), Frenchman Bay (18.7), and Casco Bay (46.1%). A smaller reduction was achieved for the St. Croix River (2.5%). The St. John River was the only watershed in Maine where CSO discharges increased in 2017, compared to 2016 volumes (from zero to 1.56 MG). The Table on page 20 - **Maine Annual CSO Volume Discharged by Watershed**, shows the reported CSO discharge

volumes for each CSO community grouped by the receiving watersheds, both for 2017 and the previous five years.

- 11) CSO discharges are well documented contributors to beach and shellfish closures. Stating with certainty that specific CSO events are solely responsible for specific closures is more difficult and is beyond the scope of this report. In some areas of the State there may be other factors that contribute to a beach or shellfishing area being closed. These may include, but are not necessarily limited to: urban storm water runoff, malfunctioning septic systems, domestic and non-domestic animal waste, agricultural runoff, and bathers. What is being assessed in this Annual Report is which beaches and shellfishing areas may have been impacted by CSO discharges.
- 12) In 2017, seven (7) CSO Communities reported possible impacts on thirteen (13) beach areas from CSO discharges. They were: Bar Harbor (Town Beach off Town Pier & Hulls Cove); Biddeford/Saco (Hills Beach, Biddeford Pool, Middle Beach, Fortunes Rock Beach & Camp Ellis); Cape Elizabeth (Cliff House Beach, Casino Beach & Fort Williams Park); Portland (East End Beach); South Portland (Willard Beach); and Calais (Red Beach – though not considered a swimming beach). The following beach advisories were reported to the Maine Healthy Beaches web-site (www.maineoastdata.org/public/CurrentBeachStatus.aspx) in 2017 due to rainfall or contamination, though not specifically identified as being caused by CSO activity: Portland, East End: 1 advisory and South Portland, Willard Beach: 4 advisories).
- 13) In 2017, five (5) CSO Communities reported that shellfishing areas could have been impacted by their CSO discharges (Bar Harbor, Biddeford, Calais, Machias, and Portland). All five (5) communities reported shellfishing area closures, which may or may not have been attributed to CSO activity.

Overall Trends and Considerations

- 1) The volume and frequency of CSO discharges vary from one wet weather event to the next based on existing groundwater conditions, frozen or thawed ground, snowmelt, and rainfall volume, duration, and intensity. To evaluate CSO abatement progress it is best to look for an historical trend in reductions, rather than totals from year to year. The chart on page 12, **Maine Statewide Combined Sewer Overflow Volume Discharged**, illustrates the continuing overall downward trend in the CSO volume discharged annually. Since 1989, the overall CSO volume discharged annually has decreased by approximately 95% statewide.
- 2) Similarly, the chart on page 13, **Maine Statewide Combined Sewer Overflow Annual Number of Discharge Events**, shows an overall downward trend in the number of overflow event days per year. Since 1989, the number of overflow event days experienced per year has decreased by approximately 85% statewide.
- 3) CSO abatement progress should not be measured solely by comparing the volumes discharged from one year to the next, because the volume discharged is influenced by variations in precipitation amounts, intensity and timing, the total area drained by the collection system, the rate of snow melt, frozen or thawed ground, and existing

groundwater levels. Even given the same annual precipitation, it is highly unlikely that any two years would result in the same volume of CSO discharges because of the complex relationship between these variables.

- 4) Trying to compare CSO abatement progress from year to year is difficult due to the varying conditions that influence the volume and frequency of overflows, not the least of which is annual precipitation patterns. To partially compensate for the fluctuation in annual precipitation patterns, the total volume of untreated combined sewage discharged can be unitized by taking into consideration the average annual precipitation received by each CSO Community. Just divide CSO volume by annual precipitation reported in inches to obtain a volume discharged per inch of precipitation. The chart on page 15, **Maine Combined Sewer Overflows Annual Volume Discharged per Inch of Precipitation**, illustrates unitized CSO discharge volume per year. This chart shows a continuing downward trend in the volume of combined sewage discharged per inch of annual precipitation. Since 1989, overflow volumes have decreased from approximately **128** million gallons per inch of precipitation to **7** million gallons per inch of precipitation, a reduction of 94.5%. The reduction in CSO discharge volume per inch of rain, mirrors the overall reduction in annual CSO discharge volume achieved statewide thus far (95.2%). This analysis is useful as a general indicator of the CSO abatement progress that is being accomplished.
- 5) Precipitation and the CSO volume discharged does not have a simple linear relationship. Still, generally, as precipitation levels increase, the volume of combined sewage being discharged per inch of precipitation would increase, because of the sewers finite capacity to capture more storm water. Once the capacity of the combined sewer system is reached, any additional rainfall or snowmelt would overflow the already inundated system.
- 6) The susceptibility of a CSO community's sewer collection system to excessive inflow and infiltration (I&I) is dependent on many factors including age and condition of pipe, degree of separation, quality of the original installation, how well the system has been maintained, etc. Therefore, wet weather conditions and precipitation patterns affect individual CSO Communities differently. Systems with a large number of catch basins or roof drains still connected, or with a high percentage of impermeable surfaces, may be influenced to a greater degree by the inflow generated by intense summer storms. In communities where the sanitary and storm systems are largely separated and inflow is not the main challenge, the cause of wet weather discharges might be more infiltration based. In these systems, a high ground water table, often occurring in the spring can promote infiltration into the collection system via leaky pipes and manholes. Therefore, direct comparisons between communities regarding their CSO abatement progress could be misleading.
- 7) From 2005 through 2016, the City of Biddeford under-estimated their CSO discharges because of flow meter issues. For this report, CSO volumes for Biddeford have been revised using a hydraulic model of the system, to more accurately reflect the level of discharge.



MAINE COMBINED SEWER OVERFLOW (CSO) COMMUNITY LIST (As of December 31, 2017)

| COMMUNITY/PERMITTEE | Outfalls | Regulators | No. of CSO Outfalls & Receiving Water |
|--|----------|------------|--|
| 1. AUBURN SEWERAGE DISTRICT | 2 | 2 | 2-Androscoggin R. |
| 2. BANGOR | 9 | 9 | 6-Kenduskeag Str., 3-Penobscot R. |
| 3. BAR HARBOR (Hulls Cove) | 1 | 1 | 1-Frenchman Bay |
| 4. BAR HARBOR (Main Plant) | 3 | 3 | 2-Frenchman Bay, 1-Eddie Brook |
| 5. BATH | 4 | 4 | 4-Kennebec R. |
| 6. BELFAST | 2 | 2 | 2-Passagassawakeag R./Belfast Hbr. |
| 7. BIDDEFORD | 7 | 14 | 8-Saco R. |
| 8. BREWER | 4 | 4 | 3-Penobscot R., 1-Sedgeunkendunk Str. |
| 9. BUCKSPORT | 0 | 0 | SWIRL to Penobscot R. |
| 10. CALAIS | 5 | 5 | 4-St. Croix R., 1-Landing Bk. |
| 11. CAPE ELIZABETH – Ottawa Road PS (Co-Permittees: So. Portland, PWD, & Cape Elizabeth)..... | 1 | 1 | 1-Atlantic O. |
| 12. GARDINER | 1 | 1 | 1-Kennebec R. |
| 13. GREATER AUGUSTA UTILITY DISTRICT (GAUD) & Hallowell Sanitary Sewers & CSO | 18 | 25 | 1-Kennedy Bk., 17-Kennebec R. |
| 14. HAMPDEN | 1 | 1 | 1-Soudabascook Str. |
| 15. KENNEBEC SANITARY TREATMENT District (KSTD).... | 3 | 3 | 3-Kennebec R. |
| 16. LEWISTON | 8 | 9 | 3-Androscoggin R., 1-Goff Bk./Hart Bk., 4-Jepson Bk. |
| 17. LEWISTON-AUBURN Water Pollution Control Authority (LAWPCA) | 1 | 1 | 1-Androscoggin R. |
| 18. MACHIAS | 2 | 2 | 2-Machias R. |
| 19. MADAWASKA | 2 | 2 | 2-St. John R. |
| 20. MECHANIC FALLS SANITARY DISTRICT | 2 | 2 | 2-Little Androscoggin R. |
| 21. MILFORD | 1 | 1 | 1-Penobscot R. |
| 22. OLD TOWN..... | 3 | 3 | 2-Penobscot R., 1-Stillwater R. |
| 23. ORONO..... | 1 | 1 | 1-Penobscot R. |
| 24. PARIS UD | 1 | 1 | 1-Little Androscoggin R. |
| 25. PORTLAND – CITY | 10 | 15 | 6-Back C., 1-Capisc Bk., 4-Portland Hbr., 1-Nason Bk. to Fore Rv. (marsh) |
| 26. PORTLAND – PORTLAND WATER DISTRICT (PWD) | 20 | 20 | 9-Back C., 3-Casco B., 4-Fore R., 2- Portland Hbr. |
| 27. RANDOLPH..... | 1 | 1 | 1-Kennebec R. |
| 28. ROCKLAND..... | 1 | 1 | 1-Rockland Hbr. |
| 29. SACO..... | 3 | 3 | 3-Saco R. |
| 30. SKOWHEGAN | 7 | 7 | 7-Kennebec R. |
| 31. SOUTH PORTLAND | 6 | 6 | 1-Barberry Ck., 1-Fore R., 1-Calvery P., 2-Portland Hbr., 1-Long Ck. |
| 32. WESTBROOK..... | 5 | 5 | 5-Presumpscot R. |
| 33. WINSLOW | 3 | 3 | 2-Sebasticook R., 1-Kennebec R. |
| 34. WINTERPORT SEWERAGE DISTRICT..... | 1 | 1 | 1-Penobscot R. |
| TOTAL CSOs | 139 | 159 | |

34 CSO Permits, permitting 31 CSO Towns/Cities

Two or more permits in one CSO Town/City

Two CSO Towns/Cities covered in one permit

Community has former CSO outfall that now receives primary treatment and disinfection.

CSO Regulator – where waste water exits the sanitary sewer system CSO Outfall – where waste water is discharged to the receiving water

Bold = 9 communities with sewer system only. Sewers discharge to a POTW controlled by another entity.

MAINE CSO COMMUNITY FLOW DATA

| Community | NPDES Permit No. | Annual Volume (Gallons) | | | | | | | | | | | | | | | | |
|--|--------------------------------|-------------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| | | 1987 | 1988 | 2003 | 2004 | 2005 | 2006 | 2007 | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 |
| Auburn S.D. | ME0100005 | 99,720,000 | 99,720,000 | 19,197,928 | 4,687,316 | 37,155,818 | 28,936,137 | 23,622,547 | 23,984,272 | 19,440,841 | 12,952,500 | 19,234,856 | 12,404,500 | 3,717,000 | 1,286,000 | 2,928,519 | 814,738 | 1,117,809 |
| Bangor | ME0100781 | 635,000,000 | 635,000,000 | 204,000,000 | 193,870,000 | 303,160,000 | 272,750,000 | 150,580,000 | 378,640,000 | 347,360,000 | 389,300,000 | 146,000,000 | 69,940,000 | 32,140,000 | 87,748,000 | 40,109,000 | 48,586,000 | 13,310,000 |
| Bar Harbor | ME0101214 & ME0102466 | 32,000,000 | 32,000,000 | 2,845,621 | 290,133 | 13,661,958 | 5,102,820 | 8,719,436 | 12,601,889 | 11,935,337 | 6,930,405 | 2,563,669 | 3,776,092 | 407,010 | 1,561,139 | 2,335,692 | 277,000 | 225,200 |
| Bath | ME0100021 | 600,000,000 | 600,000,000 | 16,496,467 | 6,055,666 | 60,338,026 | 36,105,688 | 20,783,335 | 24,383,599 | 11,323,060 | 12,930,203 | 10,067,181 | 12,199,904 | 3,297,259 | 4,990,910 | 2,727,901 | 1,608,037 | 1,697,081 |
| Belfast | ME0101532 | 736,000 | 736,000 | 0 | 0 | 1,796,747 | 485,451 | 1,035,392 | 198,370 | 260,036 | 486,919 | 490,495 | 0 | 0 | 0 | 0 | 0 | 0 |
| Biddeford | ME0100048 | 400,000,000 | 400,000,000 | 136,417,937 | 101,087,776 | 381,731,131 | 420,848,497 | 440,173,468 | 416,581,800 | 435,972,508 | 381,853,242 | 113,907,851 | 141,198,828 | 90,581,675 | 194,302,147 | 95,830,208 | 99,492,656 | 49,504,091 |
| Brewer | ME0100072 | 750,000,000 | 750,000,000 | 509,412,078 | 279,830,419 | 592,984,187 | 247,538,580 | 231,283,607 | 289,560,294 | 229,270,683 | 227,139,515 | 140,065,515 | 435,548 | 58,310 | 139,280 | 465,000 | 87,374 | 0 |
| Bucksport | ME0100111 | 53,000,000 | 53,000,000 | 53,000,000 | 371,970 | 16,623,000 | 5,546,501 | 20,000 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Calais | ME0100129 | 42,000,000 | 42,000,000 | 26,280,000 | 5,290,000 | 42,140,000 | 20,409,850 | 22,060,520 | 18,989,779 | 21,263,750 | 31,134,915 | 16,860,000 | 18,210,000 | 18,311,206 | 20,775,288 | 5,292,778 | 4,624,354 | 4,512,300 |
| Cape Elizabeth | ME0102806 | 5,400,000 | 5,400,000 | 630,000 | 1,325,000 | 4,807,000 | 5,365,000 | 3,254,000 | 2,567,000 | 3,527,000 | 3,955,292 | 1,072,000 | 2,735,000 | 41,000 | 1,440,000 | 277,000 | 251,000 | 277,000 |
| Corinna S.D.*** | ME0100153 | 40,000,000 | 40,000,000 | 2,000 | 0 | | | | | | | | | | | | | |
| Dover-Foxcroft*** | ME0100501 | 16,000 | 16,000 | 0 | 0 | 199,000 | 0 | | | | | | | | | | | |
| East Millinocket*** | ME0100196 | 1,200,000 | 1,200,000 | 0 | 0 | 0 | 0 | | | | | | | | | | | |
| Fairfield*** | ME0102393 | 300,000 | 300,000 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | |
| Fort Kent U.D.*** | ME0102369 | 3,000 | 3,000 | 2,400 | 41,000 | 600,000 | | | | | | | | | | | | |
| Gardiner | ME0101702 | 44,000,000 | 44,000,000 | 13,149,700 | 5,113,000 | 46,616,000 | 10,269,400 | 2,487,000 | 5,000,000 | 1,380,000 | 10,453,761 | 4,655,000 | 4,455,400 | 1,287,000 | 1,950,000 | 2,299,300 | 665,000 | 2,877,000 |
| Greater Augusta U.D. | ME0100013 | 72,554,000 | 72,554,000 | 7,089,337 | 3,881,421 | 26,553,055 | 14,539,424 | 10,000,000 | 48,965,215 | 15,723,000 | 49,670,000 | 31,589,000 | 38,408,000 | 26,901,000 | 17,646,000 | 21,680,000 | 7,120,000 | 3,680,000 |
| Hallowell W.D. - 2008 GAUD | ME0101010 | 350,000 | 350,000 | 100,000 | 0 | 700,000 | 150,000 | 150,000 | - | - | - | - | - | - | - | - | - | - |
| Hampden | ME0102512 | 1,201,000 | 39,600 | 262,900 | 0 | 43,862,280 | 0 | 85,000 | 0 | 500,000 | 500,000 | 500,000 | 0 | 0 | 0 | 24,105 | 151,055 | 0 |
| Kennebec S.T.D. | ME0100854 | 2,500,000 | 2,500,000 | 858,175 | 341,948 | 2,438,706 | 385,734 | 1,136,649 | 2,209,107 | 0 | 0 | 0 | 135,444 | 0 | 0 | 1,797,554 | 0 | 0 |
| Kittery*** | ME0100285 | 350,000 | 350,000 | 0 | 33,900 | 0 | | | | | | | | | | | | |
| Lewiston | ME0100994 | 208,900,000 | 208,900,000 | 199,236,985 | 82,766,343 | 249,891,633 | 159,807,018 | 90,983,189 | 152,039,341 | 116,557,656 | 113,285,042 | 78,521,909 | 90,103,658 | 32,772,894 | 21,355,331 | 30,574,217 | 25,477,213 | 12,808,039 |
| Lewiston-Auburn W.P.C.A. | ME0101478 | 480,000,000 | 480,000,000 | 113,088,000 | 83,045,000 | 480,025,000 | 265,521,000 | 142,286,000 | 292,244,000 | 207,794,000 | 156,986,000 | 108,278,048 | 113,380,000 | 63,567,000 | 68,569,000 | 27,838,000 | 18,694,000 | 21,856,000 |
| Lincoln S.D.*** | ME0101796 | 2,400,000 | 2,400,000 | | | | | | | | | | | | | | | |
| Lisbon*** | ME0100307 | 600,000 | 600,000 | 0 | 0 | | | | | | | | | | | | | |
| Livermore Falls*** | ME0100315 | | | | | | | | | | | | | | | | | |
| Machias | ME0100323 | 7,000,000 | 7,000,000 | 2,533,245 | 2,124,118 | 6,646,222 | 3,008,025 | 2,263,720 | 2,328,905 | 4,073,938 | 2,791,962 | 1,180,678 | 938,330 | 1,857,988 | 2,202,444 | 1,067,647 | 910,259 | 203,815 |
| Madawaska | ME 0101681 | 3,200,000 | 3,200,000 | 100,000 | 1,749,764 | 8,215,460 | 3,700,002 | 2,667,765 | 24,194,225 | 15,800,000 | 1,107,610 | 1,490,000 | 377,488 | 349,400 | 1,830,563 | 0 | 0 | 1,562,430 |
| Mechanic Falls S.D. | ME0100391 | 18,000,000 | 18,000,000 | 2,389,769 | 963,114 | 11,765,409 | 9,419,000 | 11,853,000 | 11,223,600 | 6,231,000 | 9,250,000 | 5,033,002 | 9,638,035 | 3,663,997 | 1,385,675 | 1,013,807 | 927,473 | 603,528 |
| Milford | ME0102695 | 220,000 | 220,000 | 220,000 | 220,000 | 0 | 211,070 | 0 | 88,365 | 66,285 | 52,006 | 407,151 | 26,970 | 0 | 10,000 | 25,000 | 20,000 | 0 |
| Milo W.D.*** | ME0100439 | 10,000 | 10,000 | 2,000 | 0 | 10,000 | 0 | 501,000 | 750 | | | | | | | | | |
| Old Town | ME0100471 | 6,300,000 | 6,300,000 | 6,296,537 | 425,832 | 4,779,340 | 321,105 | 770,699 | 254,967 | 0 | 125,000 | 0 | 0 | 0 | 0 | 30,000 | 10,000 | 0 |
| Orono | ME0100498 | 31,000,000 | 31,000,000 | 1,179,000 | 0 | 18,467,330 | 1,314,000 | 7,360,000 | 4,820,000 | 371,471 | 2,416,910 | 1,260,837 | 0 | 0 | 0 | 1,320,000 | 1,461,000 | 0 |
| Paris U.D. | ME 0100951 | 1,000,000 | 1,000,000 | 175,000 | 0 | 288,000 | 173,500 | 206,000 | 84,000 | 0 | 110,000 | 0 | 1,020,000 | 0 | 0 | 0 | 0 | 0 |
| Portland & PWD | City-ME0101435 / PWD-ME0102075 | 1,800,000,000 | 1,800,000,000 | 454,680,000 | 607,351,945 | 1,296,000,000 | 1,816,525,856 | 589,203,712 | 883,105,087 | 872,751,281 | 780,188,153 | 496,288,000 | 704,319,257 | 179,403,901 | 414,421,500 | 254,663,330 | 318,359,691 | 175,675,000 |
| Presque Isle*** | ME0100561 | 27,500,000 | 27,500,000 | | | | | | | | | | | | | | | |
| Randolph | ME0102423 | 10,000,000 | 10,000,000 | 432,500 | 0 | 1,058,039 | 266,256 | 459,476 | 1,413,880 | 488,645 | 285,719 | 223,934 | 988,434 | 50,054 | 101,183 | 0 | 515,240 | 0 |
| Rockland | ME0100595 | 47,000,000 | 47,000,000 | 20,000,000 | 7,000,000 | 0 | 0 | 0 | 0 | 0 | 0 | | | | | 0 | 0 | 0 |
| Saco | ME 0101117 | 176,000,000 | 176,000,000 | 5,758,842 | 10,313,025 | 176,214,902 | 38,451,182 | 1,950,000 | 100,000 | 27,015 | 924,014 | 1,372,128 | 2,964,929 | 1,100,985 | 1,739,425 | 1,057,000 | 599,000 | 304,000 |
| Sanford S.D.*** | ME0100617 | 4,000,000 | 4,000,000 | 0 | 0 | 0 | 15,000 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | | |
| Skowhegan | ME0100625 | 48,000,000 | 48,000,000 | 22,768,111 | 12,082,768 | 47,873,323 | 31,314,358 | 21,596,631 | 61,963,453 | 6,073,919 | 7,550,855 | 4,757,994 | 4,238,875 | 4,746,538 | 3,861,193 | 6,786,698 | 4,168,672 | 738,844 |
| South Portland | ME0100633 | 500,000,000 | 500,000,000 | 7,896,125 | 19,812,914 | 26,810,104 | 26,118,706 | 15,727,553 | 12,883,433 | 12,183,196 | 42,095,393 | 14,906,594 | 37,134,882 | 1,858,579 | 15,531,600 | 11,161,602 | 6,240,350 | 2,033,229 |
| Westbrook | ME0100846 | 50,000,000 | 50,000,000 | 7,000 | 944,000 | 11,119,000 | 40,636,729 | 15,879,000 | 7,379,066 | 7,069,280 | 14,105,989 | 12,202,000 | 18,903,485 | 6,222,000 | 11,932,000 | 4,423,000 | 7,447,100 | 1,285,000 |
| Winslow | ME0102628 | 1,300,000 | 1,300,000 | 0 | 0 | 23,652 | 0 | 725,000 | 235,000 | 5,001 | 200,000 | 63,354 | 1,327,119 | 7,070 | 0 | 164,549 | 70,144 | 237,400 |
| Winterport S.D. | ME0100749 | 680,000 | 680,000 | 570,000 | 91,000 | 677,800 | 0 | 102,000 | 252,000 | 18,000 | 0 | 0 | 0 | 0 | 60,000 | 90,000 | 0 | 0 |
| Yarmouth*** | ME0100765 | 1,000 | 1,000 | | | | | | | | | | | | | | | |
| Total Annual Discharge Volume (Gallons) | | 6,203,441,000 | 6,202,279,600 | 1,827,077,657 | 1,431,109,372 | 3,915,232,122 | 3,465,235,889 | 1,819,925,699 | 2,678,291,397 | 2,347,466,902 | 2,258,781,405 | 1,212,991,196 | 1,289,260,178 | 472,341,866 | 874,838,678 | 515,981,907 | 548,577,356 | 294,507,766 |
| Total Annual Discharge Volume (Billion Gallons) | | 6.20 | 6.20 | 1.83 | 1.43 | 3.92 | 3.47 | 1.82 | 2.68 | 2.35 | 2.26 | 1.21 | 1.29 | 0.47 | 0.87 | 0.52 | 0.55 | 0.29 |

Note: For legibility, discharge volume data for years 1989-2002 are not shown. Communities highlighted in gray are no longer a CSO Community. Biddeford CSO volumes 2005-2016 have been adjusted due to under-estimation of flows.

MAINE CSO COMMUNITY ANNUAL NUMBER OF CSO DISCHARGE EVENTS

| Community | NPDES Permit No. | 1987 | 1988 | 2003 | 2004 | 2005 | 2006 | 2007 | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 |
|---|-----------------------------------|-------------|-------------|------------|------------|-------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| Auburn S.D. | ME0100005 | 80 | 80 | 62 | 24 | 58 | 37 | 42 | 59 | 61 | 37 | 11 | 8 | 5 | 5 | 2 | 8 | 2 |
| Bangor | ME0100781 | 53 | 53 | 49 | 42 | 46 | 58 | 25 | 65 | 78 | 73 | 54 | 29 | 27 | 34 | 20 | 28 | 21 |
| Bar Harbor | ME0101214 & ME0102466 | 155 | 155 | 16 | 5 | 22 | 18 | 10 | 27 | 28 | 19 | 6 | 13 | 6 | 17 | 5 | 2 | 3 |
| Bath | ME0100021 | 64 | 64 | 23 | 20 | 33 | 32 | 25 | 29 | 21 | 20 | 12 | 23 | 18 | 18 | 8 | 14 | 10 |
| Belfast | ME0101532 | 7 | 7 | 0 | 0 | 5 | 3 | 5 | 4 | 3 | 6 | 3 | 0 | 0 | 0 | 1 | 0 | 0 |
| Biddeford | ME0100048 | 180 | 180 | 93 | 61 | 104 | 82 | 70 | 53 | 46 | 28 | 100 | 146 | 77 | 88 | 48 | 57 | 55 |
| Brewer | ME0100072 | 95 | 95 | 66 | 72 | 78 | 45 | 38 | 59 | 56 | 50 | 45 | 5 | 3 | 3 | 1 | 2 | 0 |
| Bucksport | ME0100111 | 53 | 53 | 25 | 8 | 24 | 18 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Calais | ME0100129 | 15 | 15 | 15 | 9 | 15 | 5 | 8 | 10 | 14 | 8 | 6 | 14 | 8 | 14 | 6 | 7 | 9 |
| Cape Elizabeth | ME0102806 | 5 | 5 | 2 | 5 | 20 | 20 | 5 | 11 | 17 | 12 | 6 | 11 | 2 | 12 | 2 | 6 | 2 |
| Corinna S.D. | ME0100153 | 30 | 30 | 1 | 0 | | | | | | | | | | | | | |
| Dover-Foxcroft | ME0100501 | 8 | 8 | 0 | 0 | 2 | 0 | | | | | | | | | | | |
| East Millinocket | ME0100196 | 11 | 11 | 0 | 0 | 0 | 0 | | | | | | | | | | | |
| Fairfield | ME0102393 | 15 | 15 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | | |
| Fort Kent U.D. | ME0102369 | 10 | 10 | 2 | 1 | 4 | | | | | | | | | | | | |
| Gardiner | ME0101702 | 40 | 40 | 24 | 11 | 41 | 14 | 2 | 8 | 2 | 12 | 6 | 6 | 3 | 3 | 2 | 2 | 5 |
| Greater Augusta U.D. | ME0100013 | 80 | 80 | 70 | 58 | 73 | 50 | 29 | 34 | 35 | 32 | 37 | 29 | 22 | 29 | 17 | 17 | 29 |
| Hallowell W.D. - 2008 GAUD | ME0101010 | 14 | 14 | 2 | 0 | 14 | 3 | 3 | - | - | - | - | - | - | - | - | - | - |
| Hampden | ME0102512 | 1 | 3 | 2 | 0 | 13 | 0 | 1 | 0 | 1 | 1 | 1 | 0 | 0 | 0 | 1 | 1 | 0 |
| Kennebec S.T.D. | ME0100854 | 15 | 15 | 5 | 7 | 9 | 3 | 1 | 4 | 0 | 0 | 0 | 1 | 0 | 0 | 1 | 0 | 0 |
| Kittery | ME0100285 | 7 | 7 | 0 | 1 | 0 | | | | | | | | | | | | |
| Lewiston | ME0100994 | 80 | 80 | 55 | 65 | 69 | 70 | 38 | 71 | 58 | 68 | 45 | 38 | 27 | 23 | 37 | 35 | 28 |
| Lewiston-Auburn W.P.C.A. | ME0101478 | 80 | 80 | 23 | 35 | 49 | 44 | 29 | 38 | 36 | 44 | 37 | 22 | 32 | 26 | 17 | 17 | 10 |
| Lincoln S.D. | ME0101796 | 10 | 10 | | | | | | | | | | | | | | | |
| Lisbon | ME0100307 | 5 | 5 | 0 | 0 | | | | | | | | | | | | | |
| Livermore Falls | ME0100315 | | | | | | | | | | | | | | | | | |
| Machias | ME0100323 | 15 | 15 | 16 | 8 | 15 | 10 | 5 | 12 | 13 | 9 | 7 | 9 | 6 | 13 | 7 | 8 | 7 |
| Madawaska | ME 0101681 | 16 | 16 | 7 | 4 | 65 | 14 | 17 | 18 | 32 | 17 | 10 | 8 | 3 | 7 | 0 | 0 | 3 |
| Mechanic Falls S.D. | ME0100391 | 42 | 42 | 20 | 12 | 29 | 23 | 9 | 42 | 42 | 18 | 39 | 28 | 17 | 30 | 17 | 25 | 12 |
| Milford | ME0102695 | 8 | 8 | 8 | 8 | 0 | 8 | 0 | 4 | 1 | 3 | 2 | 1 | 0 | 1 | 1 | 1 | 0 |
| Milo W.D. | ME0100439 | 3 | 3 | 1 | 0 | 1 | 0 | 2 | 1 | | | | | | | | | |
| Old Town | ME0100471 | 25 | 25 | 7 | 1 | 13 | 1 | 4 | 4 | 0 | 1 | 0 | 0 | 0 | 0 | 1 | 1 | 0 |
| Orono | ME0100498 | 30 | 30 | 2 | 0 | 12 | 3 | 6 | 7 | 3 | 3 | 2 | 0 | 0 | 0 | 2 | 4 | 0 |
| Paris U.D. | ME 0100951 | 5 | 5 | 1 | 0 | 2 | 2 | 2 | 2 | 0 | 4 | 0 | 4 | 0 | 0 | 0 | 0 | 0 |
| Portland & PWD | City-ME0101435 / PWD-ME0102075 | 100 | 100 | 71 | 86 | 88 | 93 | 58 | 87 | 104 | 79 | 88 | 70 | 63 | 75 | 58 | 56 | 38 |
| Presque Isle | ME0100561 | 26 | 26 | | | | | | | | | | | | | | | |
| Randolph | ME0102423 | 23 | 23 | 2 | 0 | 8 | 3 | 1 | 9 | 7 | 3 | 2 | 2 | 1 | 2 | 0 | 2 | 0 |
| Rockland | ME0100595 | 23 | 23 | 6 | 2 | 0 | 0 | 0 | 0 | 0 | | | | | | | 0 | 0 |
| Saco | ME 0101117 | 44 | 44 | 22 | 32 | 41 | 24 | 12 | 12 | 9 | 10 | 4 | 21 | 15 | 19 | 13 | 12 | 7 |
| Sanford S.D. | ME0100617 | 10 | 10 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | | | | |
| Skowhegan | ME0100625 | 160 | 160 | 77 | 53 | 81 | 81 | 55 | 58 | 17 | 23 | 21 | 25 | 36 | 28 | 20 | 23 | 23 |
| South Portland | ME0100633 | 23 | 23 | 10 | 10 | 20 | 20 | 5 | 10 | 10 | 12 | 13 | 12 | 7 | 9 | 2 | 3 | 2 |
| Westbrook (PWD) | ME0100846 | 50 | 50 | 7 | 13 | 17 | 31 | 55 | 50 | 11 | 12 | 16 | 13 | 60 | 70 | 49 | 38 | 2 |
| Winslow | ME0102628 | 20 | 20 | 0 | 0 | 1 | 0 | 3 | 3 | 3 | 2 | 3 | 9 | 1 | 0 | 1 | 3 | 1 |
| Winterport S.D. | ME0100749 | 8 | 8 | 8 | 1 | 2 | 0 | 1 | 1 | 1 | 0 | 0 | 0 | 0 | 1 | 2 | 0 | 0 |
| Yarmouth | ME0100765 | 4 | 4 | | | | | | | | | | | | | | | |
| Total Number of CSO Discharge Events | | 1748 | 1750 | 800 | 654 | 1074 | 816 | 568 | 792 | 709 | 606 | 576 | 547 | 439 | 527 | 341 | 372 | 269 |

Note: For legibility, discharge event data for years 1989-2002 are not shown. Communities highlighted in gray are no longer a CSO Community.

MAINE CSO COMMUNITY ANNUAL NUMBER OF CSO OUTFALLS


| Community | NPDES Permit No. | Year Unknown | 1987 | 1988 | 2003 | 2004 | 2005 | 2006 | 2007 | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 |
|--|--------------------------------|--------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Auburn S.D. | ME0100005 | 11 | 11 | 11 | 6 | 6 | 6 | 5 | 4 | 3 | 3 | 3 | 2 | 3 | 2 | 2 | 1 | 2 | 2 |
| Bangor | ME0100781 | 22 | 22 | 22 | 12 | 12 | 12 | 11 | 11 | 7 | 7 | 7 | 9 | 9 | 9 | 9 | 9 | 9 | 9 |
| Bar Harbor | ME0101214 & ME0102466 | 5 | 5 | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| Bath | ME0100021 | 9 | 9 | 9 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| Belfast | ME0101532 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| Biddeford | ME0100048 | 16 | 16 | 16 | 11 | 11 | 11 | 11 | 11 | 10 | 10 | 10 | 10 | 10 | 8 | 8 | 8 | 8 | 7 |
| Brewer | ME0100072 | 10 | 10 | 10 | 7 | 7 | 7 | 7 | 6 | 6 | 6 | 5 | 5 | 4 | 4 | 4 | 4 | 4 | 4 |
| Bucksport | ME0100111 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Calais | ME0100129 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 |
| Cape Elizabeth | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 0 |
| Corinna S.D. | ME0100153 | 5 | 5 | 5 | 1 | 0 | | | | | | | | | | | | | |
| Dover-Foxcroft | ME0100501 | 15 | 15 | 15 | 4 | 4 | 4 | 4 | | | | | | | | | | | |
| East Millinocket | ME0100196 | 5 | 5 | 5 | 1 | 1 | 1 | 1 | | | | | | | | | | | |
| Fairfield | ME0102393 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 0 | | | | |
| Fort Kent U.D. | ME0102369 | 6 | 6 | 6 | 1 | 1 | 1 | | | | | | | | | | | | |
| Gardiner | ME0101702 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Greater Augusta U.D. | ME0100013 | 31 | 31 | 31 | 24 | 24 | 24 | 23 | 23 | 24 | 23 | 22 | 22 | 19 | 18 | 18 | 18 | 18 | 18 |
| Hallowell W.D. - 2008 GAUD | ME0101010 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | - | - | - | - | - | - | - | - | - | |
| Hampden | ME0102512 | 6 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Kennebec S.T.D. | ME0100854 | 5 | 5 | 5 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Kittery | ME0100285 | 3 | 3 | 3 | 3 | 3 | 3 | | | | | | | | | | | | |
| Lewiston | ME0100994 | 32 | 32 | 32 | 30 | 30 | 26 | 24 | 23 | 22 | 22 | 20 | 18 | 18 | 16 | 11 | 10 | 8 | 8 |
| Lewiston-Auburn W.P.C.A. | ME0101478 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Lincoln S.D. | ME0101796 | 1 | 1 | 1 | 0 | | | | | | | | | | | | | | |
| Lisbon | ME0100307 | 6 | 6 | 6 | 2 | 2 | | | | | | | | | | | | | |
| Livermore Falls | ME0100315 | 5 | 5 | 5 | 0 | | | | | | | | | | | | | | |
| Machias | ME0100323 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| Madawaska | ME 0101681 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| Mechanic Falls S.D. | ME0100391 | 4 | 4 | 4 | 1 | 1 | 1 | 1 | 1 | 3 | 3 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 |
| Milford | ME0102695 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Milo W.D. | ME0100439 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | | | | | | | |
| Old Town | ME0100471 | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Orono | ME0100498 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Paris U.D. | ME 0100951 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Portland & PWD | City-ME0101435 / PWD-ME0102075 | 42 | 42 | 42 | 34 | 34 | 34 | 33 | 33 | 33 | 33 | 32 | 32 | 31 | 31 | 31 | 31 | 30 | 30 |
| Presque Isle | ME0100561 | 1 | 1 | 1 | 0 | | | | | | | | | | | | | | |
| Randolph | ME0102423 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Rockland | ME0100595 | 8 | 8 | 8 | 4 | 4 | 4 | 3 | 2 | 2 | | | | | | 1 | 1 | 1 | 1 |
| Saco | ME 0101117 | 9 | 9 | 9 | 5 | 5 | 5 | 5 | 5 | 6 | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| Sanford S.D. | ME0100617 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 1 | 1 | 1 | 1 | 1 | 0 | | | | |
| Skowhegan | ME0100625 | 10 | 10 | 10 | 9 | 9 | 9 | 9 | 9 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 |
| South Portland | ME0100633 | 35 | 28 | 28 | 8 | 7 | 6 | 5 | 5 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 |
| Westbrook (PWD) | ME0100846 | 7 | 7 | 7 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 |
| Winslow | ME0102628 | 2 | 2 | 2 | 2 | 1 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 2 | 2 | 2 | 2 | 3 | 3 |
| Winterport S.D. | ME0100749 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| Yarmouth | ME0100765 | 2 | 2 | 2 | 0 | | | | | | | | | | | | | | |
| Total Annual CSO Discharge Outfalls | | 350 | 338 | 338 | 215 | 212 | 205 | 193 | 183 | 177 | 171 | 164 | 163 | 159 | 149 | 145 | 143 | 142 | 139 |

Note: For legibility, outfall data for years 1989-2002 are not shown. Communities highlighted in gray are no longer a CSO Community.


MAINE - STATEWIDE COMBINED SEWER OVERFLOW (CSO) VOLUME DISCHARGED




12

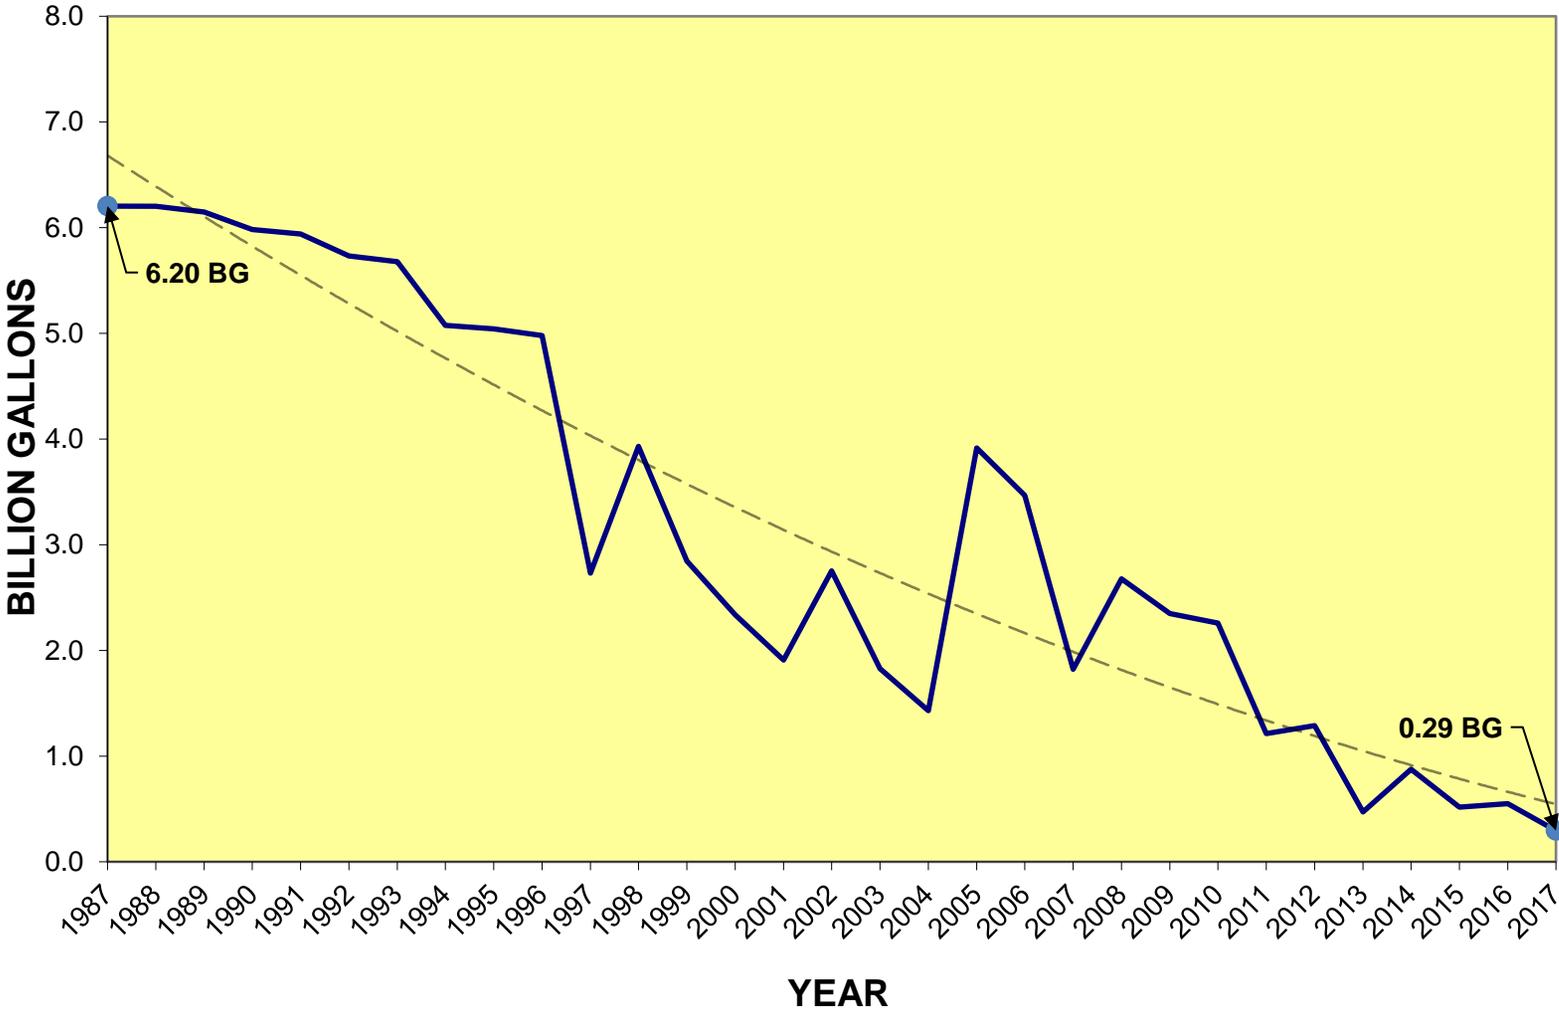


MAINE - STATEWIDE COMBINED SEWER OVERFLOW (CSO) ANNUAL NUMBER OF DISCHARGE EVENTS

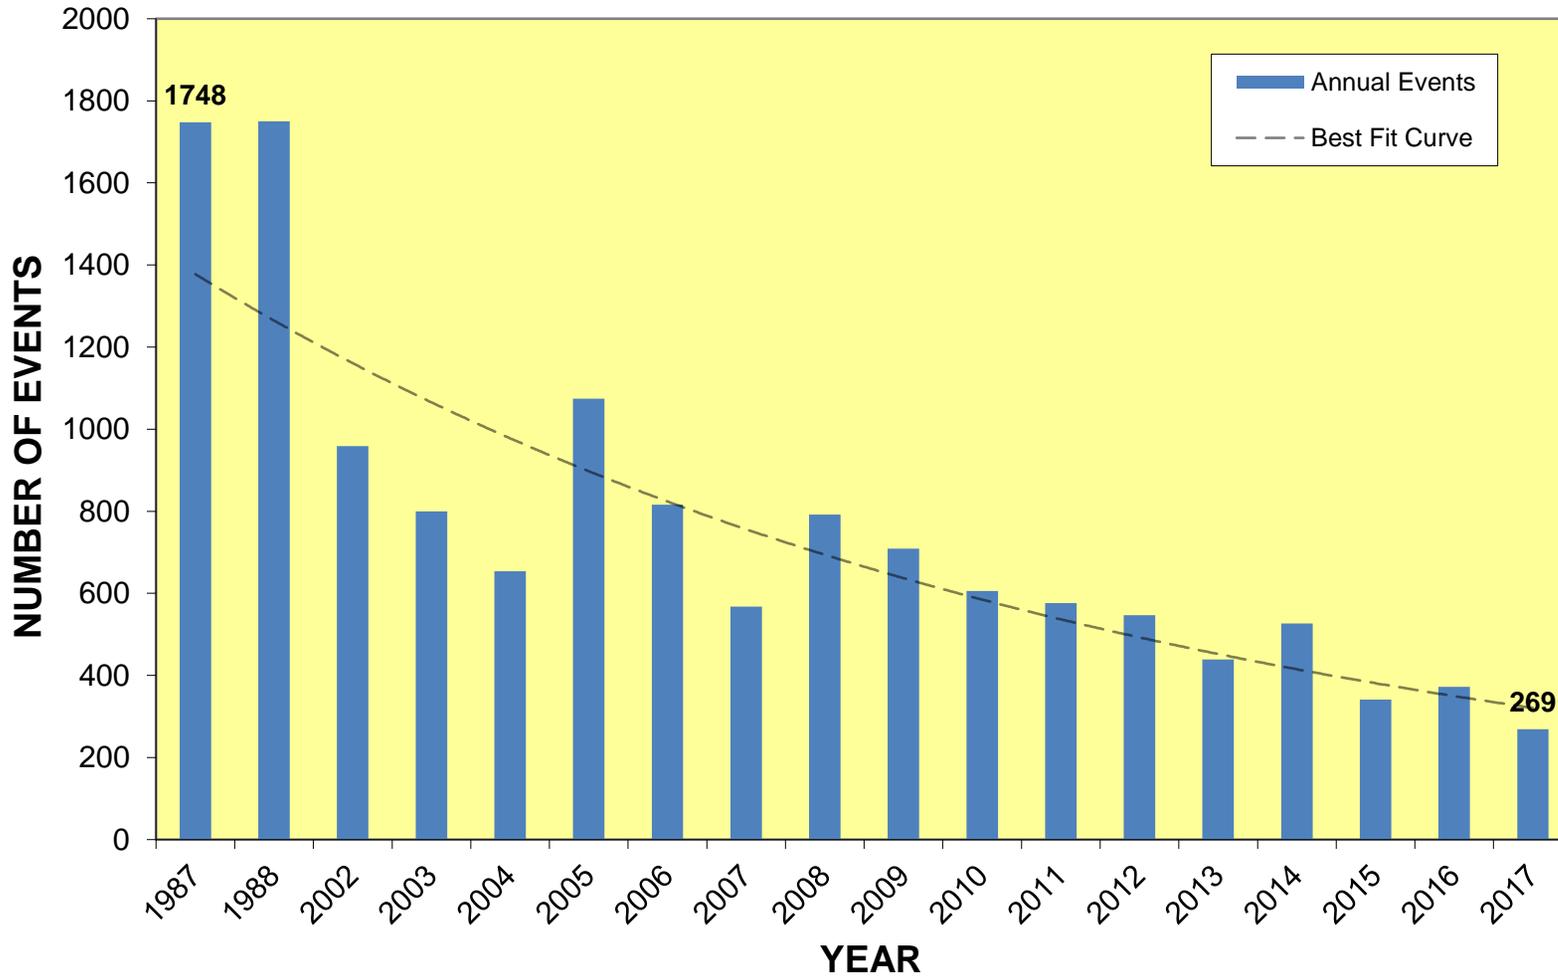


MAINE - STATEWIDE COMBINED SEWER OVERFLOW (CSO) OUTFALLS

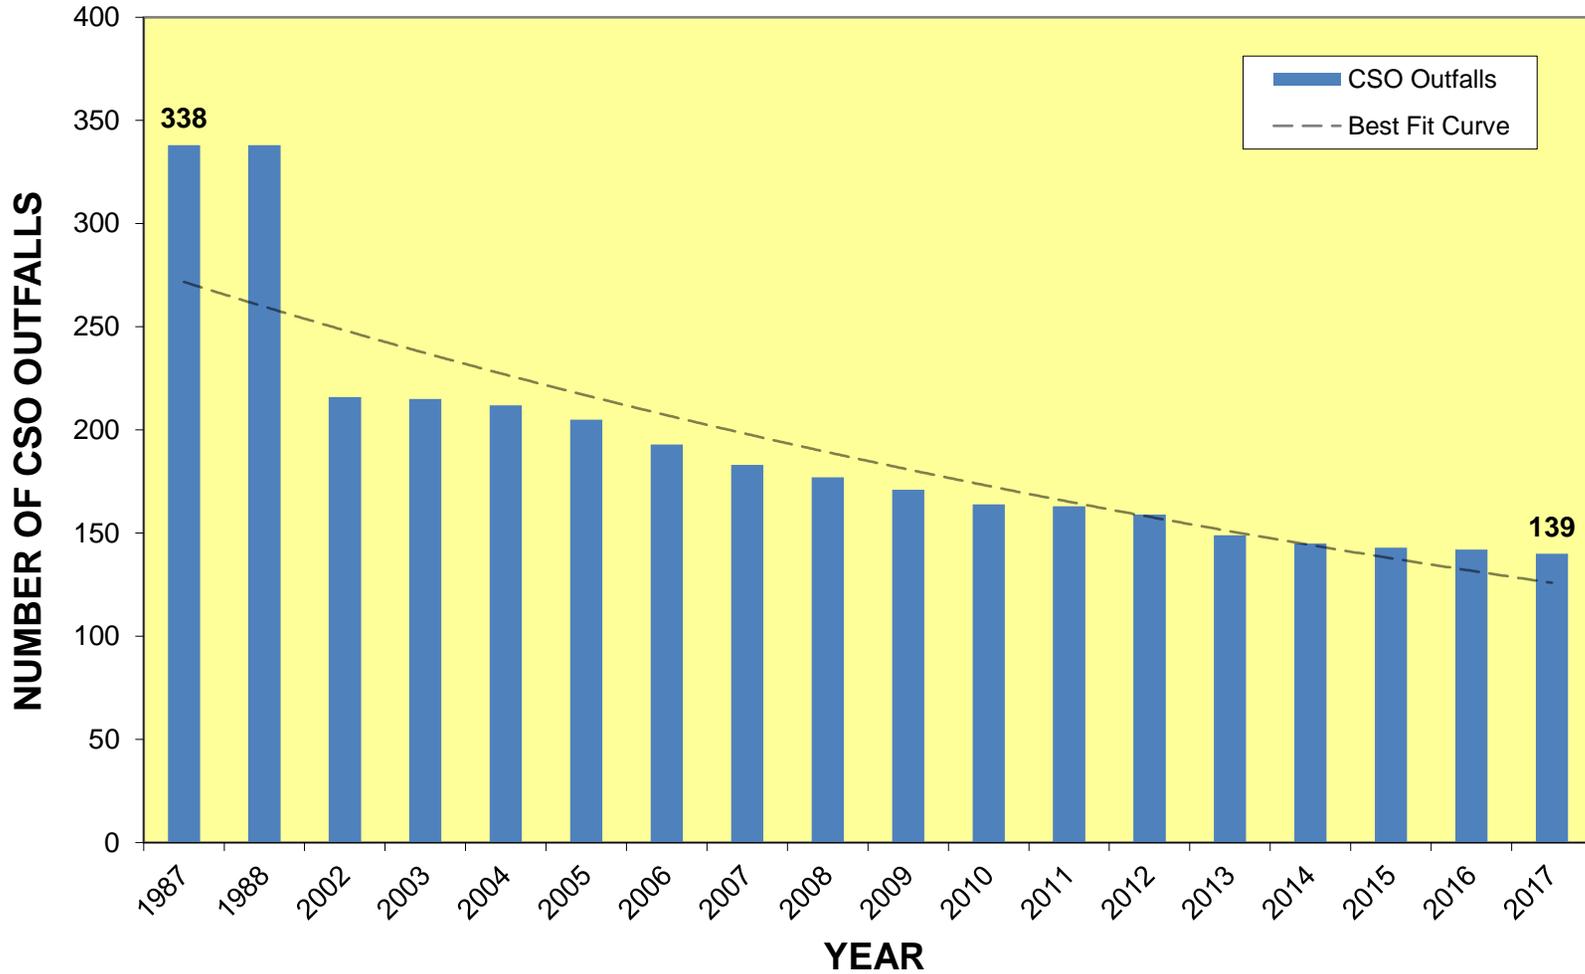


MAINE - COMBINED SEWER OVERFLOWS ANNUAL VOLUME DISCHARGED PER INCH PRECIPITATION

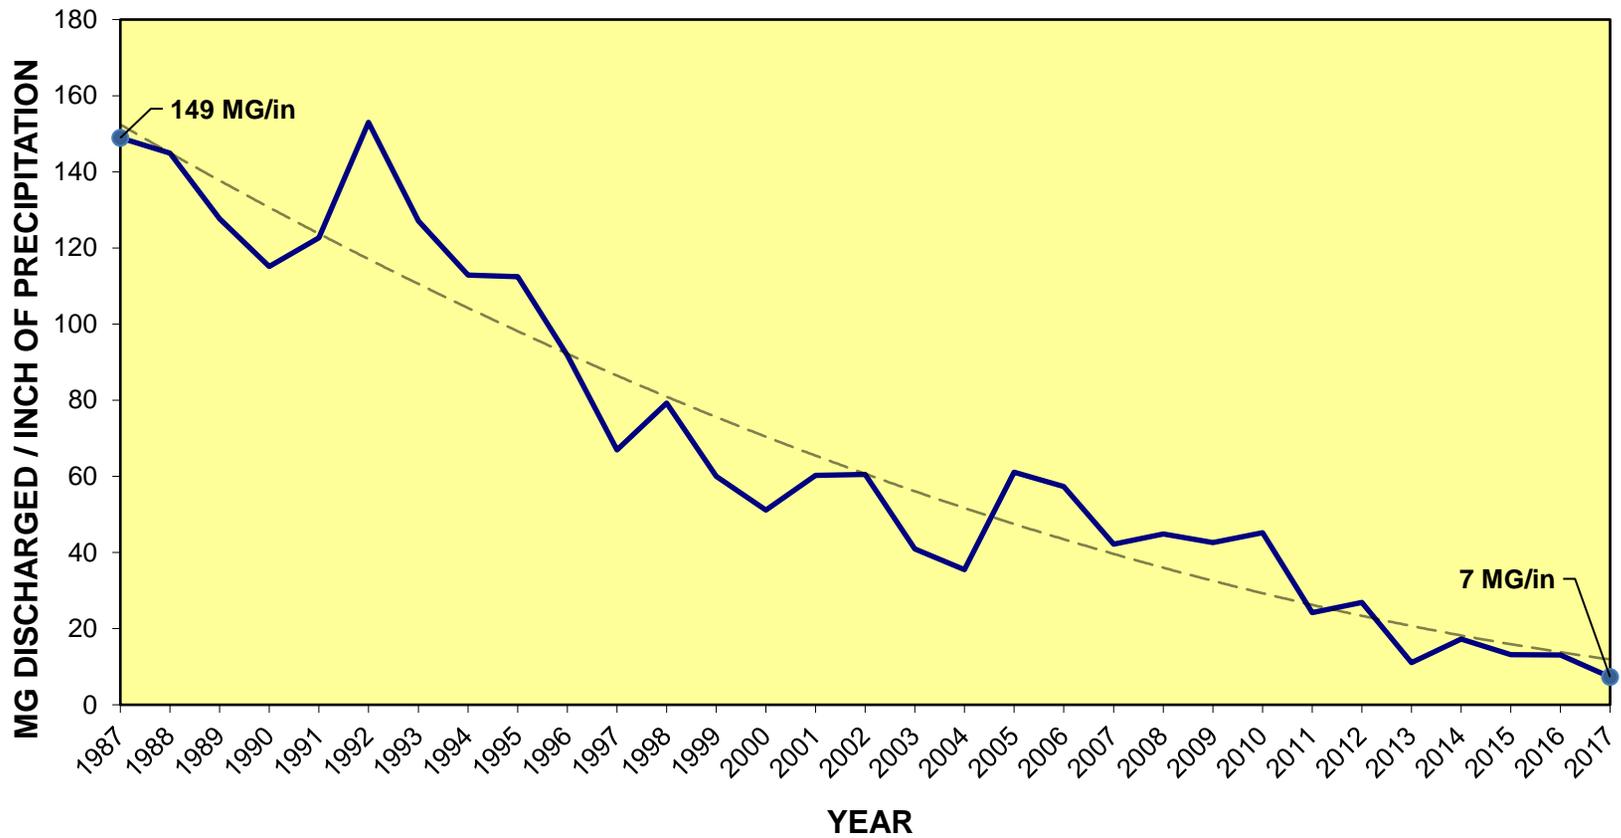

MAINE - YEARLY CSO VOLUMES AND PRECIPITATION

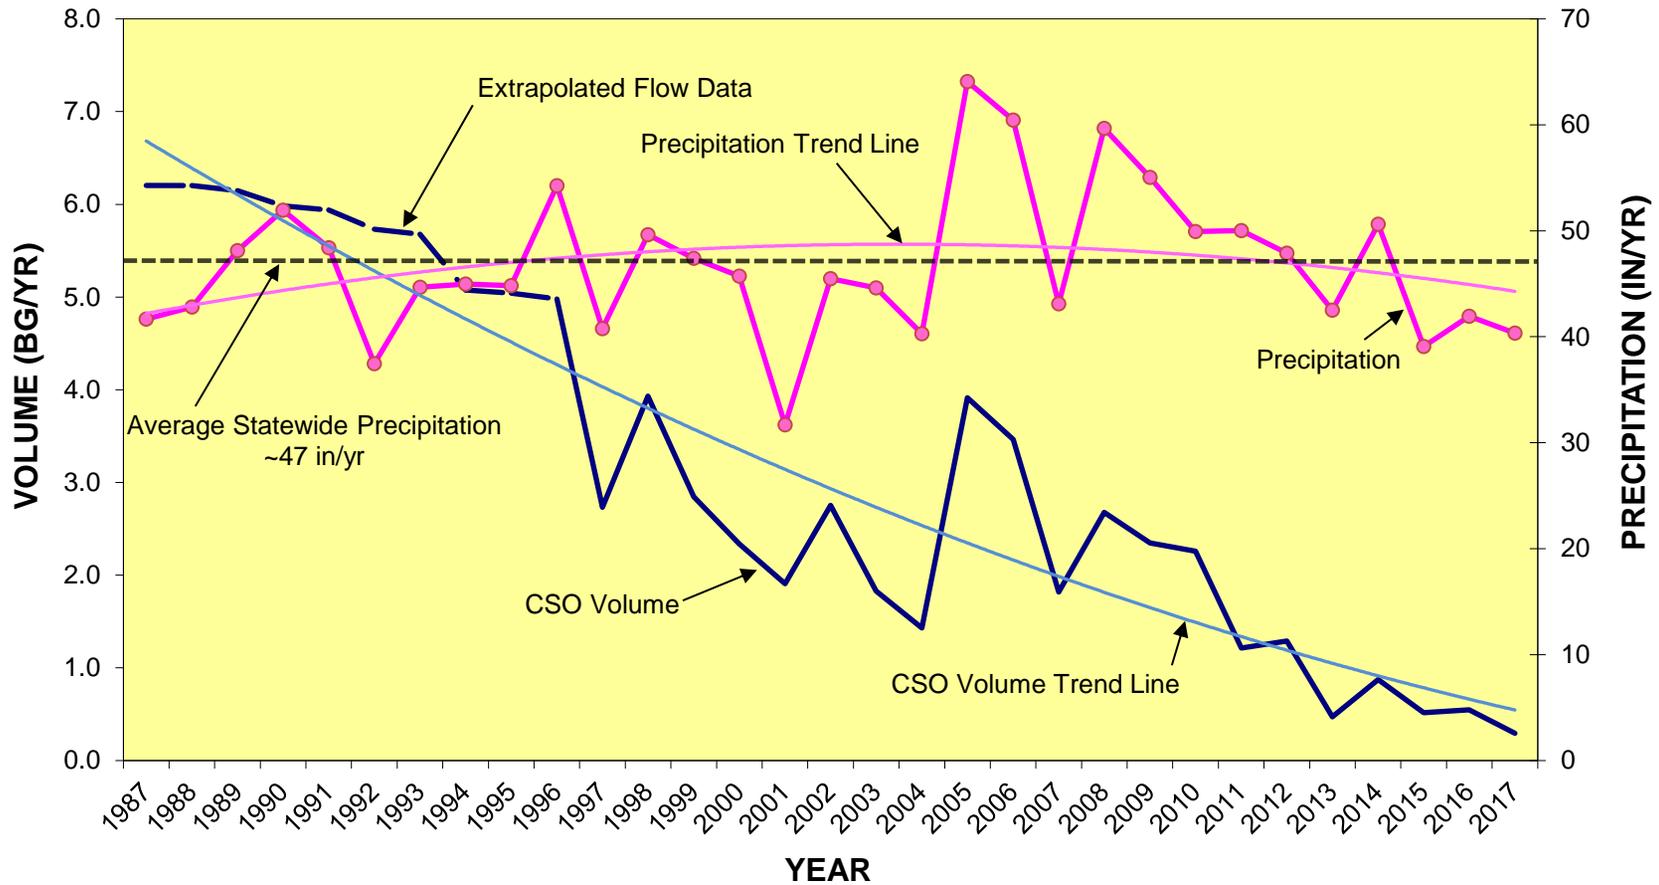


Maine 2017 CSO FLOW COMPARISON 31 CSO COMMUNITIES 20 DISCHARGERS - 0.29 BILLION GALLONS

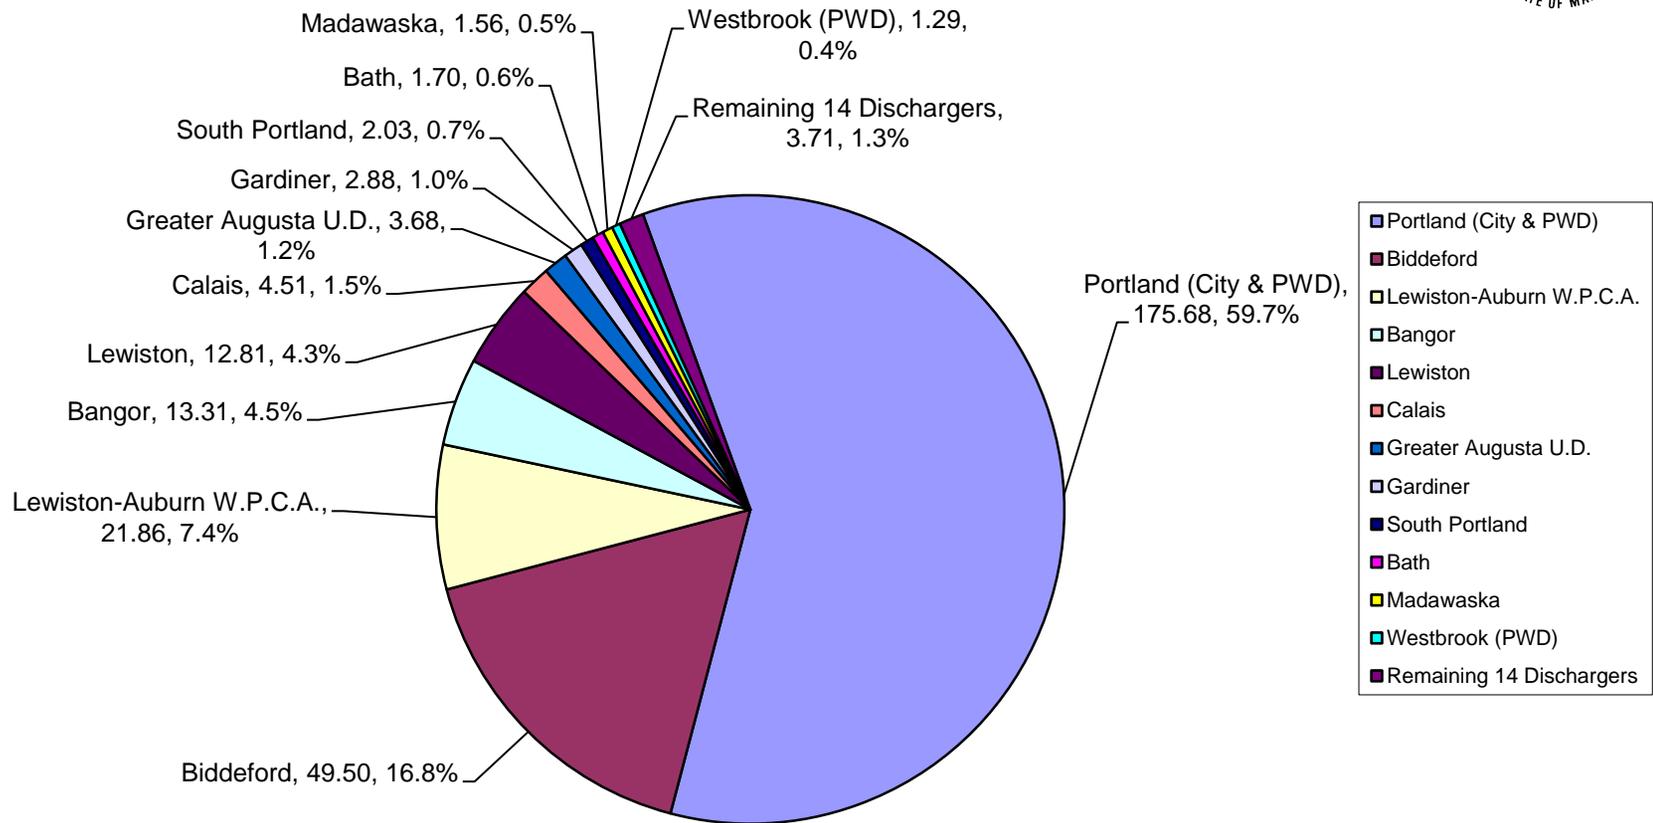


Discharger, Overflow in Million Gallons (MG), Percent of Total

Maine 2017 CSO FLOW COMPARISON BY COMMUNITY (0.29 Billion Gallons)

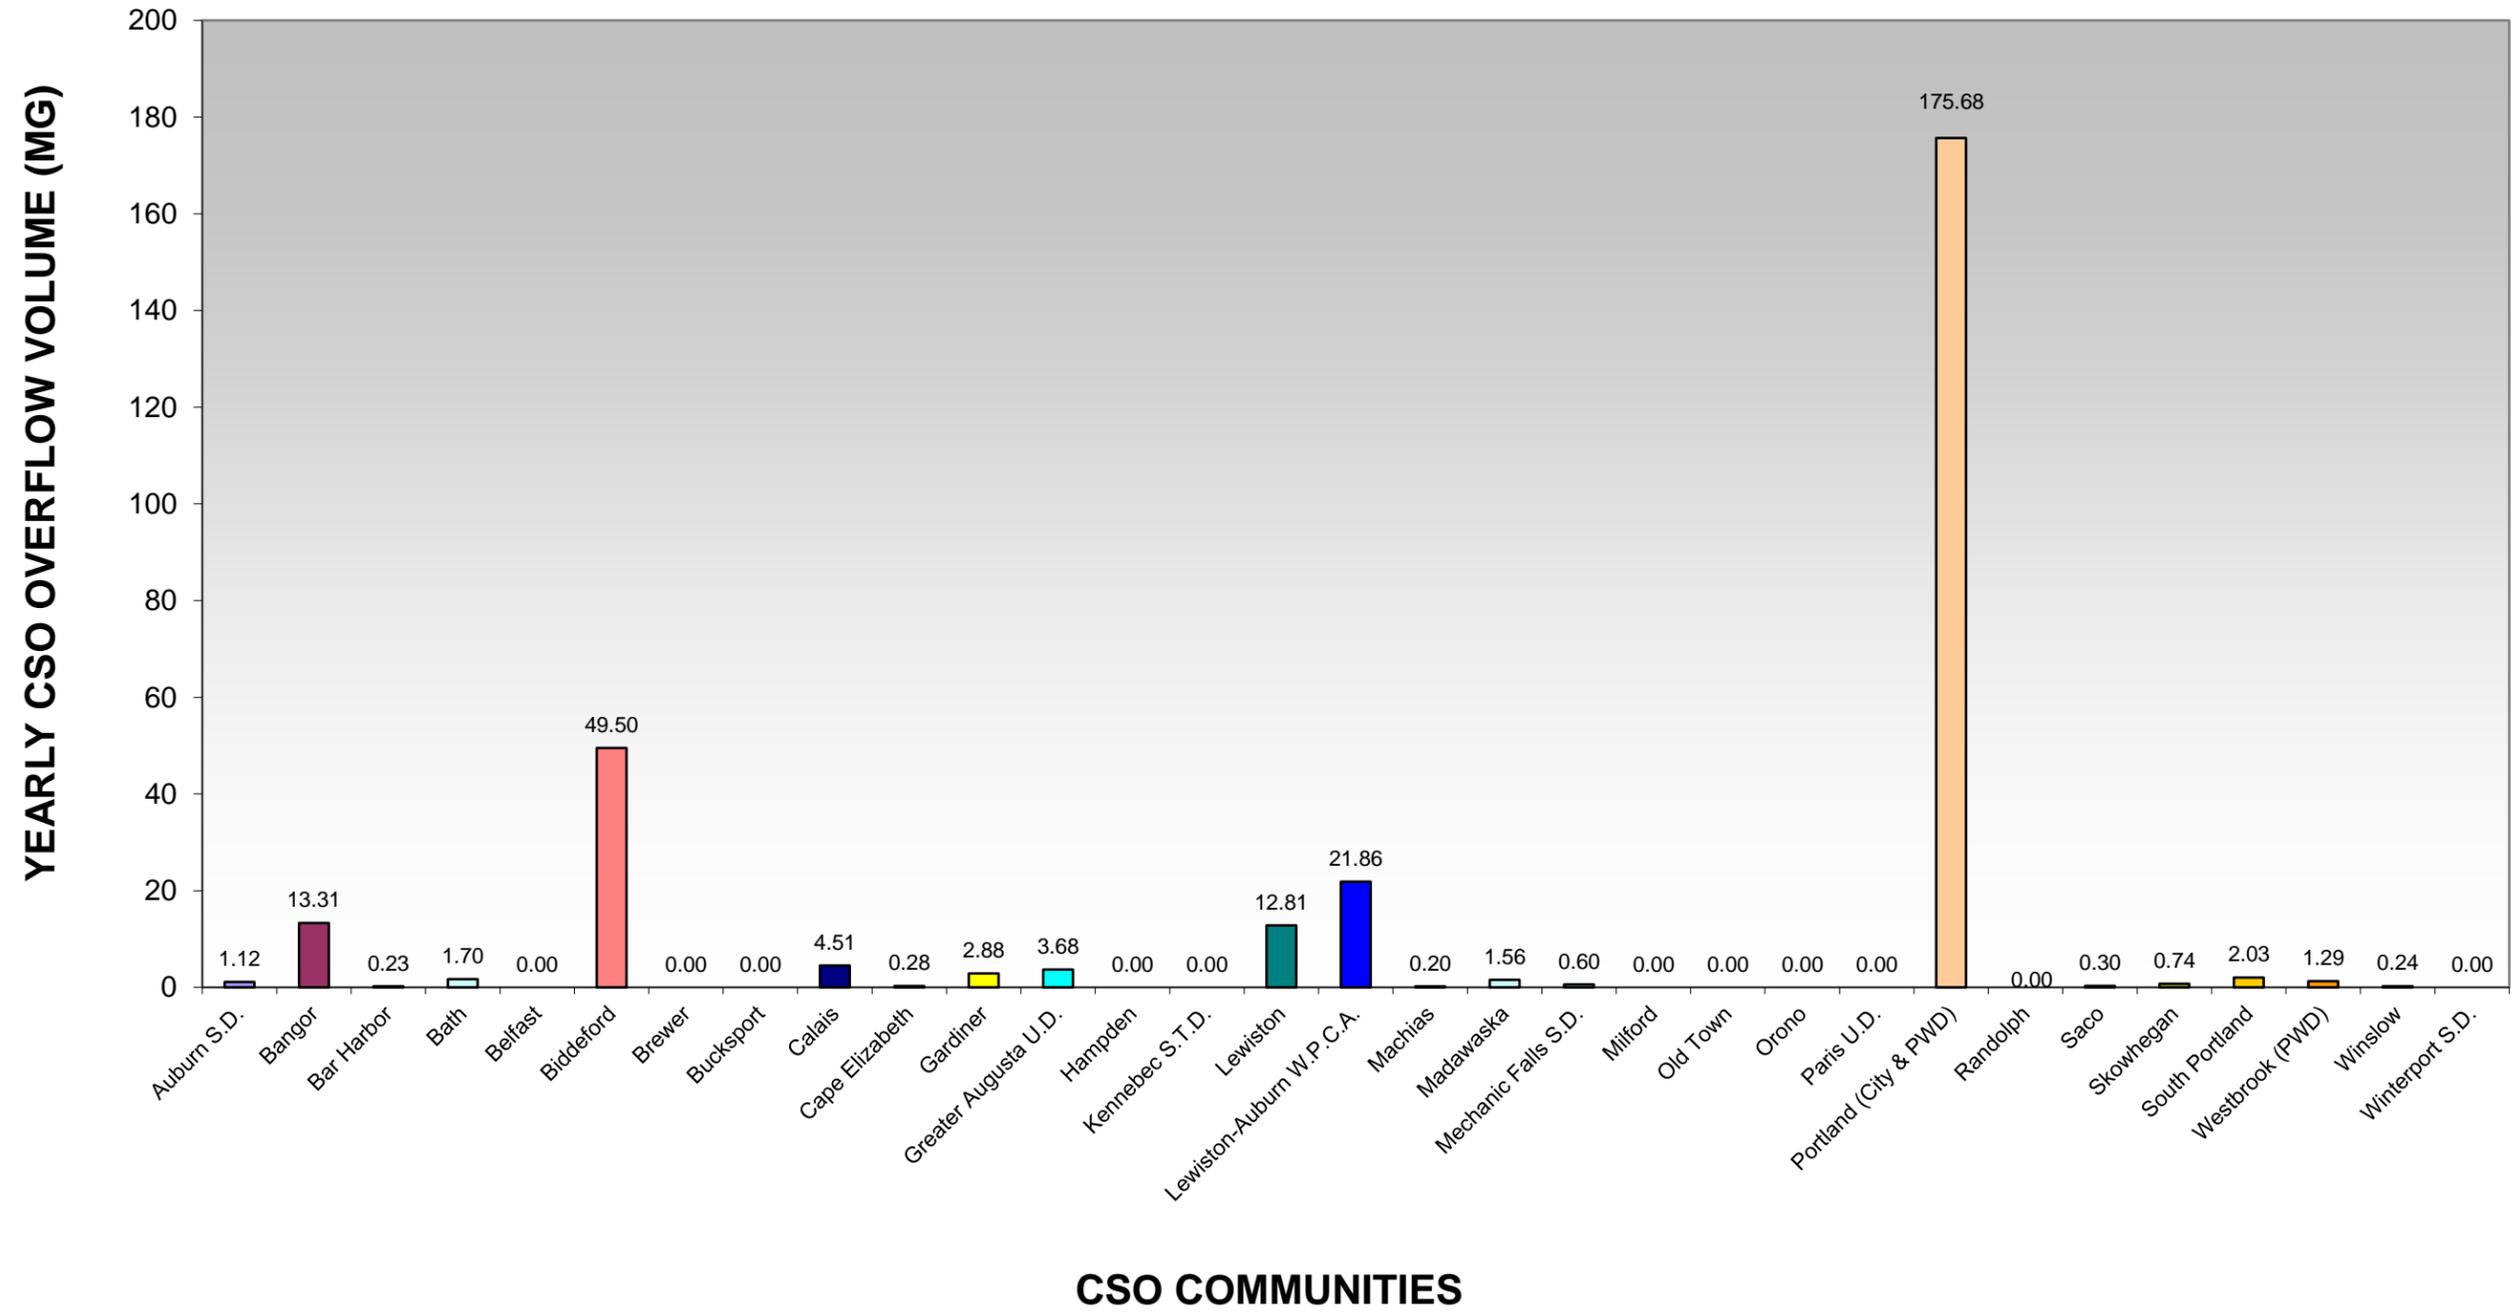

Maine 2017 CSO Volume Discharged by Watershed (0.29 Billion Gallons)

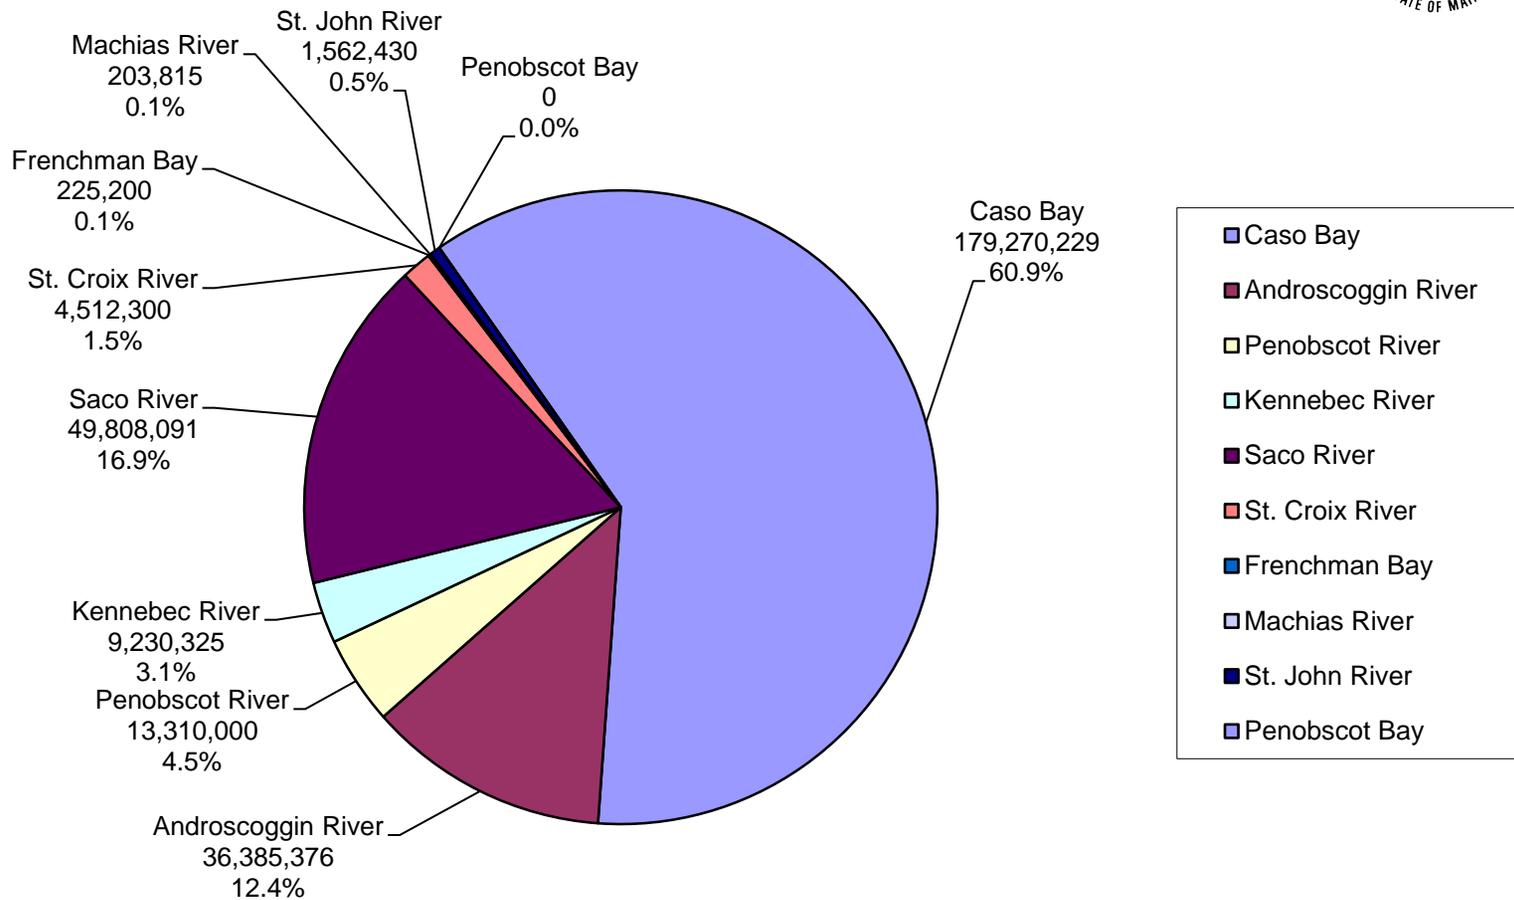

Receiving Waterbody, Overflow in Gallons, Percent of Total

MAINE ANNUAL CSO VOLUME DISCHARGED BY WATERSHED

| | | Annual Discharge Volume (Gallons) | | | | | | |
|--------------------|----------------------|-----------------------------------|----------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| Community | | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 | |
| Androscoggin River | Auburn SD | 12,404,500 | 3,717,000 | 1,286,000 | 2,928,519 | 814,738 | 1,117,809 | |
| | Lewiston-Auburn WPCA | 113,380,000 | 63,567,000 | 68,569,000 | 27,838,000 | 18,694,000 | 21,856,000 | |
| | Lewiston | 90,103,658 | 32,772,894 | 21,355,331 | 30,574,217 | 25,477,213 | 12,808,039 | |
| | Mechanic Falls SD | 9,638,035 | 3,663,997 | 1,385,675 | 1,013,807 | 927,473 | 603,528 | |
| | Paris UD | 1,020,000 | 0 | 0 | 0 | 0 | 0 | |
| | Sub Total | 226,546,193 | 103,720,891 | 92,596,006 | 62,354,543 | 45,913,424 | 36,385,376 | |
| Casco Bay | Cape Elizabeth | 2,735,000 | 41,000 | 1,440,000 | 277,000 | 251,000 | 277,000 | |
| | Portland-City & PWD | 704,319,257 | 179,403,901 | 414,421,500 | 254,663,330 | 318,359,691 | 175,675,000 | |
| | South Portland | 37,134,882 | 1,858,579 | 15,531,600 | 11,161,602 | 6,240,350 | 2,033,229 | |
| | Westbrook | 18,903,485 | 6,222,000 | 11,932,000 | 4,423,000 | 7,447,100 | 1,285,000 | |
| | | Sub Total | 763,092,624 | 187,525,480 | 443,325,100 | 270,524,932 | 332,298,141 | 179,270,229 |
| Frenchman Bay | Bar Harbor | 3,776,092 | 407,010 | 1,561,139 | 2,335,692 | 277,000 | 225,200 | |
| | | Sub Total | 3,776,092 | 407,010 | 1,561,139 | 2,335,692 | 277,000 | 225,200 |
| Kennebec River | Bath | 12,199,904 | 3,297,259 | 4,990,910 | 2,727,901 | 1,608,037 | 1,697,081 | |
| | Gardiner | 4,455,400 | 1,287,000 | 1,950,000 | 2,299,300 | 665,000 | 2,877,000 | |
| | Greater Augusta UD | 38,408,000 | 26,901,000 | 17,646,000 | 21,680,000 | 7,120,000 | 3,680,000 | |
| | Kennebec STD | 135,444 | 0 | 0 | 1,797,554 | 0 | 0 | |
| | Randolph | 988,434 | 50,054 | 101,183 | 0 | 515,240 | 0 | |
| | Skowhegan | 4,238,875 | 4,746,538 | 3,861,193 | 6,786,698 | 4,168,672 | 738,844 | |
| | Winslow | 1,327,119 | 7,070 | 0 | 164,549 | 70,144 | 237,400 | |
| | Sub Total | 61,753,176 | 36,288,921 | 28,549,286 | 35,456,002 | 14,147,093 | 9,230,325 | |
| Machias River | Machias | 938,330 | 1,857,988 | 2,202,444 | 1,067,647 | 910,259 | 203,815 | |
| | | Sub Total | 938,330 | 1,857,988 | 2,202,444 | 1,067,647 | 910,259 | 203,815 |
| Penobscot Bay | Belfast | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Rockland | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | Sub Total | 0 | 0 | 0 | 0 | 0 | 0 |
| Penobscot River | Bangor | 69,940,000 | 32,140,000 | 87,748,000 | 40,109,000 | 48,586,000 | 13,310,000 | |
| | Brewer | 435,548 | 58,310 | 139,280 | 465,000 | 87,374 | 0 | |
| | Hampden | 0 | 0 | 0 | 24,105 | 151,055 | 0 | |
| | Milford | 26,970 | 0 | 10,000 | 25,000 | 20,000 | 0 | |
| | Old Town | 0 | 0 | 0 | 30,000 | 10,000 | 0 | |
| | Orono | 0 | 0 | 0 | 1,320,000 | 1,461,000 | 0 | |
| | Winterport SD | 0 | 0 | 60,000 | 90,000 | 0 | 0 | |
| | Sub Total | 70,402,518 | 32,198,310 | 87,957,280 | 42,063,105 | 50,315,429 | 13,310,000 | |
| Saco River | Biddeford | 141,198,828 | 90,581,675 | 194,302,147 | 95,830,208 | 99,492,656 | 49,504,091 | |
| | Saco | 2,964,929 | 1,100,985 | 1,739,425 | 1,057,000 | 599,000 | 304,000 | |
| | | Sub Total | 144,163,757 | 91,682,660 | 196,041,572 | 96,887,208 | 100,091,656 | 49,808,091 |
| St. Croix River | Calais | 18,210,000 | 18,311,206 | 20,775,288 | 5,292,778 | 4,624,354 | 4,512,300 | |
| | | Sub Total | 18,210,000 | 18,311,206 | 20,775,288 | 5,292,778 | 4,624,354 | 4,512,300 |
| St. John River | Madawaska | 377,488 | 349,400 | 1,830,563 | 0 | 0 | 1,562,430 | |
| | | Sub Total | 377,488 | 349,400 | 1,830,563 | 0 | 0 | 1,562,430 |
| | | Total Annual Volume | 1,289,260,178 | 472,341,866 | 874,838,678 | 515,981,907 | 548,577,356 | 294,507,766 |